

# YOUR DRINKING WATER IN 2016

## ANNUAL WATER QUALITY REPORT

### **Contra Costa Water District**

Calvin Liu  
925-688-8091

### **City of Antioch**

Lori Sarti  
925-779-7024

### **City of Martinez**

925-372-3588

### **City of Pittsburg**

Ana Corti  
925-252-6916

### **Diablo Water District (Oakley)**

Nacho Mendoza  
925-625-2112

### **Golden State Water Company**

(Bay Point)  
925-458-3112

### **City of Brentwood**

Eric Brennan  
925-516-6000

### **To Our Customers:**

We are pleased to present the 2016 Annual Water Quality Report that shows the high quality of your drinking water. Your water providers are investing in the infrastructure and technology that will ensure all of our customers will enjoy safe, reliable drinking water for generations. Every year, we provide a report full of water quality data so you can get a better understanding of your drinking water.

**In 2016, the treated drinking water we delivered was better than all drinking water standards set by the state and federal governments. For test results, see Pages 7-11.**


This report includes water quality data collected throughout 2016 and answers questions you might have about your tap water. You can be confident your tap water is of a high quality. Frequent testing for water quality and regular improvements in the treatment process keeps your drinking water among the best in the country. Recent reports about lead in the water systems of communities like Flint, Michigan, have people understandably concerned. Your water provider takes steps to reduce the potential for lead to leach from your home's water pipes. We do this through proactive monitoring and corrosion control. The results from more than 270 water samples collected from our five agencies in 2015 and 2016 are included in the tables of this report and show that lead was not detected. Read more about lead on Page 3.

We hope you find this report useful in illustrating the high-quality of your water service. If you have questions about the tap water in your community, please call the contact on the left.

## SAFETY STANDARDS ENSURE QUALITY

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

### Contaminants that may be present in source water:

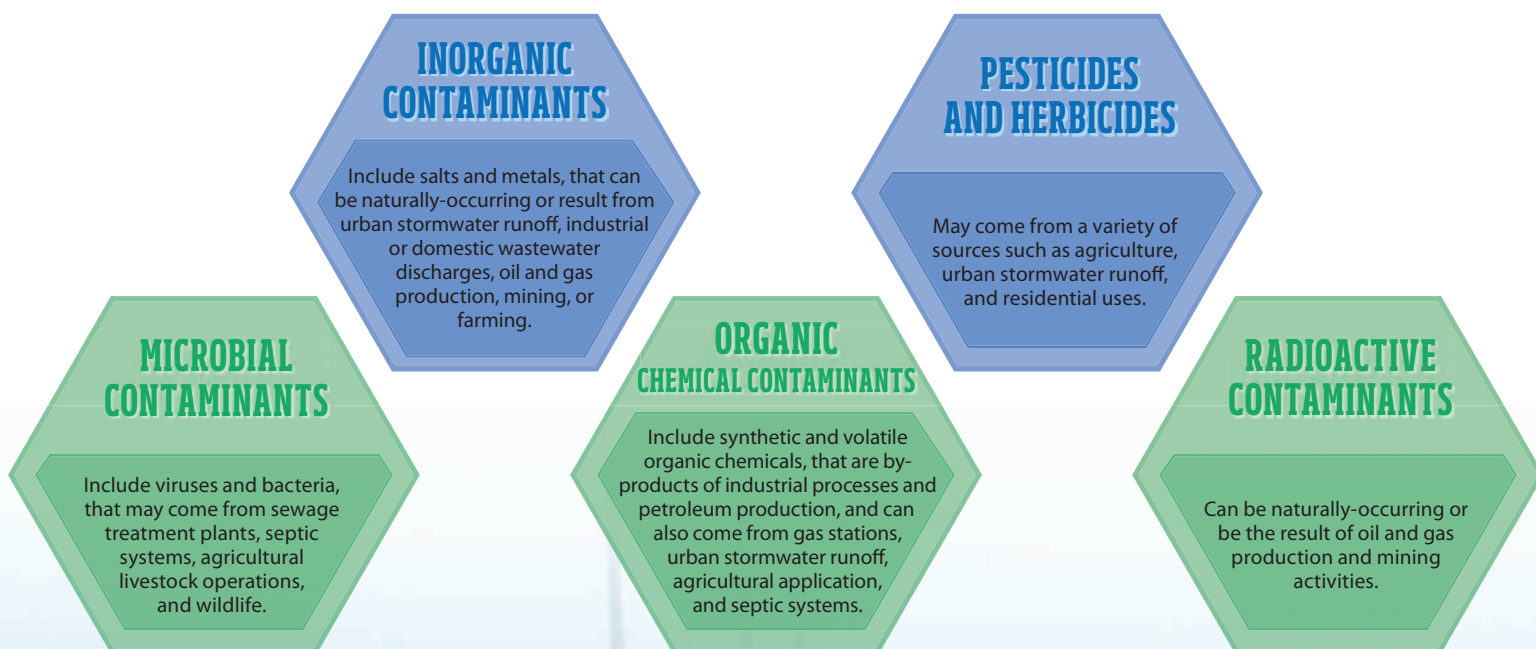

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (USEPA) and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. State Board regulations also establish limits for contaminants in bottled water that provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

### Notice for Vulnerable Populations

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

# WATER QUALITY NOTIFICATIONS

## Lead

No water provider included in this report detected lead above the regulatory action level in their water supply. If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and plumbing in buildings and homes. Your drinking water supplier is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at 1-800-426-4791 or at <http://www.epa.gov/lead>. A recent California directive allows schools to receive lead-in-water testing from their water provider. To find out more about the Lead Sampling of Drinking Water in Schools initiative, please visit [http://www.waterboards.ca.gov/drinking\\_water/certlic/drinkingwater/leadsamplinginschools.shtml](http://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/leadsamplinginschools.shtml)

## Fluoride

To prevent tooth decay, fluoride is added to your drinking water. This is a long-standing practice that has improved public health over many years. To read about fluoridation, visit [www.waterboards.ca.gov/drinking\\_water/certlic/drinkingwater/Fluoridation.shtml](http://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Fluoridation.shtml)

## Cryptosporidium

*Cryptosporidium* is a microbial pathogen found in surface water throughout the U.S. Although filtration removes *Cryptosporidium*, the most commonly-used filtration methods cannot guarantee 100 percent removal. Our monitoring indicates the presence of these organisms in our source water and/or finished water. Current test methods do not allow us to determine if the organisms are dead or if they are capable of causing disease. Ingestion of *Cryptosporidium* may cause cryptosporidiosis, an abdominal infection. Symptoms of infection include nausea, diarrhea, and abdominal cramps. Most healthy individuals can overcome the disease within a few weeks. However, immuno-compromised people, infants and small children, and the elderly are at greater risk of developing life-threatening illness. We encourage immuno-compromised individuals to consult their doctor regarding appropriate precautions to take to avoid infection. *Cryptosporidium* must be ingested to cause disease, and it may be spread through means other than drinking water.



# THE SOURCE OF YOUR WATER

## Contra Costa Water District

CCWD provides treated drinking water to homes and businesses in Clayton, Clyde, Concord, Pacheco, Port Costa, and parts of Martinez, Pleasant Hill and Walnut Creek. Water is pumped from the Delta, treated and then delivered to customers through a network of distribution pipes.

In June 2002 and May 2003, source water assessments were conducted at the Old River, Rock Slough and Mallard Slough intakes, the Los Vaqueros, Contra Loma, Mallard and Martinez reservoirs, and the Contra Costa Canal at Clyde. A source water assessment was conducted for the Middle River Intake in 2012. The assessments were based on a review of data collected from 1996 through 2001, as well as a review of the activities and facilities located at or near each source. In summary:

- **Intakes** were found to be most vulnerable to the effects of saltwater intrusion, agricultural drainage, recreational boating and regulated point discharges.
- **Reservoirs** were found to be most vulnerable to the effects of associated recreation, roads and parking lots, and watershed runoff.
- **Contra Costa Canal** was found to be most vulnerable to gas stations, chemical/petroleum processing/storage, septic systems, historic landfills and military institutions.

CCWD completes watershed sanitary surveys every five years and the last one was completed in 2015. The surveys concluded that potential contamination is regularly mitigated by the natural flushing of the Delta, controls at contamination sources and existing water treatment practices.


## Bay Point

The Golden State Water Company purchases treated water from CCWD and delivers it to customers through its distribution pipes.

## Brentwood

CCWD operates the City of Brentwood's treatment plant to treat water for the City. For complete information about the City's drinking water, visit [www.brentwoodca.gov/gov/pw/water/reports.asp](http://www.brentwoodca.gov/gov/pw/water/reports.asp)

Your primary water source is surface water from the Sacramento-San Joaquin River Delta. Though Delta water quality fluctuates throughout the year, investments made by your water provider ensures the water delivered to your tap is of a consistent high-quality. Contra Costa Water District diverts water from four locations in the Delta: Rock Slough near Oakley, Old River near Discovery Bay, Middle River on Victoria Island, and Mallard Slough in Bay Point. CCWD's major conveyance facilities are the Contra Costa Canal, the Los Vaqueros Pipeline and the Multi-Purpose Pipeline.

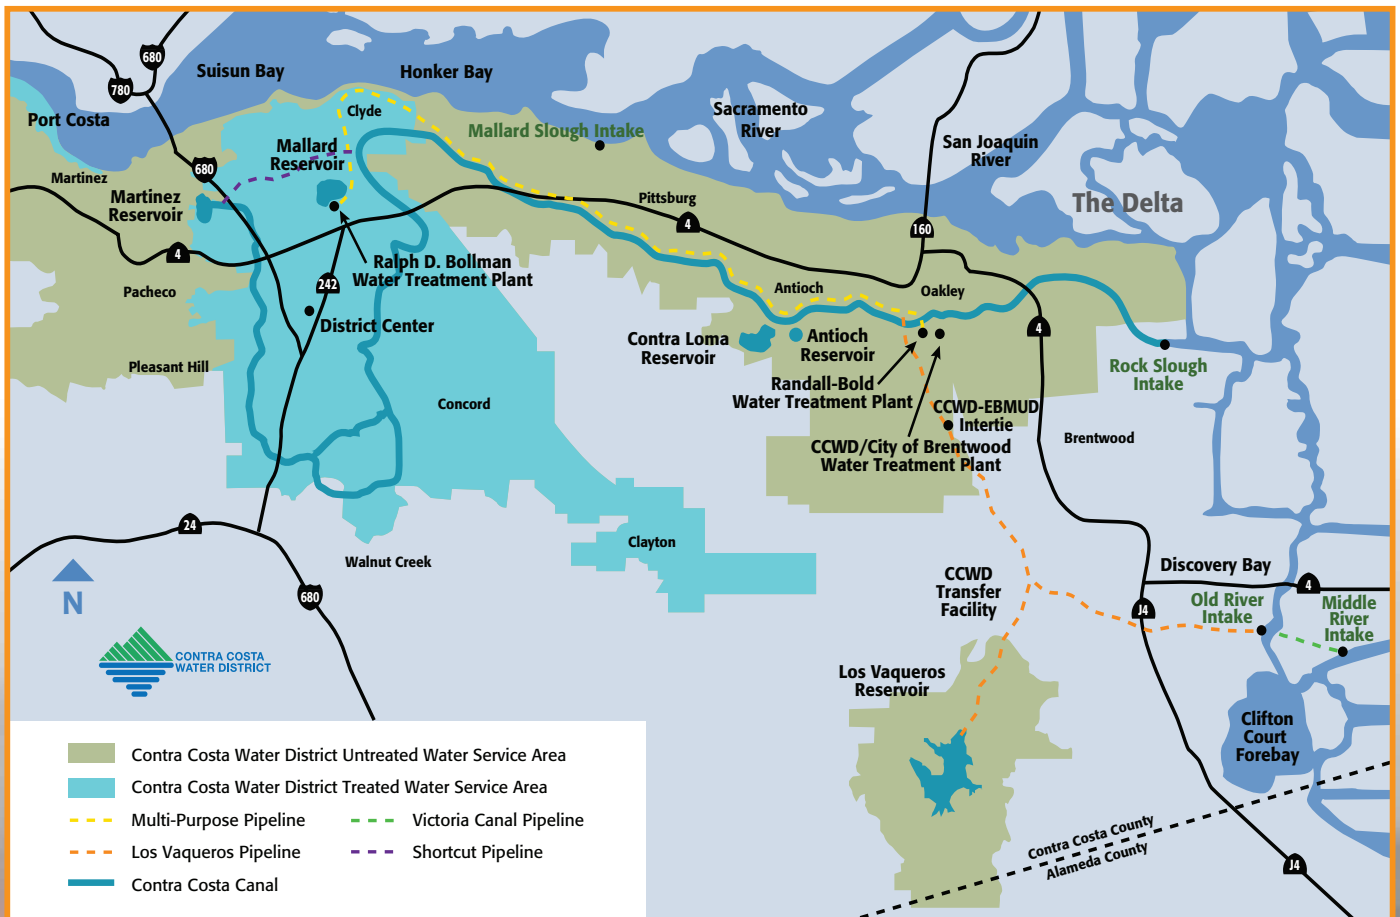

# HOW TO READ THE TABLES

The following tables contain detailed information about the water that is delivered to your home or business. Your water is regularly tested for more than 120 chemicals and substances, as well as radioactivity. Only those constituents that were detected in 2016 are listed in the tables. Constituents may vary from provider to provider depending on water source and treatment techniques.

## STATE OR FEDERAL GOAL

The level of a contaminant in drinking water below which there is no known or expected risk to health.

## AVERAGE

The average level of a detected contaminant in drinking water.

|                                  | STATE OR FEDERAL GOAL<br>(PHG, MCLG OR MRDLG) | HIGHEST AMOUNT<br>ALLOWED<br>(MCL OR MRDL) | Water Provider |         | MAJOR SOURCE IN DRINKING WATER                                                                                           |
|----------------------------------|-----------------------------------------------|--------------------------------------------|----------------|---------|--------------------------------------------------------------------------------------------------------------------------|
|                                  |                                               |                                            | RANGE DETECTED | AVERAGE |                                                                                                                          |
| Primary Drinking Water Standards | Contaminants that may affect health           |                                            |                |         |                                                                                                                          |
| INORGANIC                        |                                               |                                            |                |         |                                                                                                                          |
| Fluoride (mg/L)                  | 1                                             | 2.0                                        | 0.6-0.8        | 0.7     | Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories |

## HIGHEST AMOUNT ALLOWED

The highest level of a contaminant that is allowed in drinking water.

## MAJOR SOURCE IN DRINKING WATER

The most likely way a contaminant enters drinking water.

## Definitions & Abbreviations

**Maximum Contaminant Level (MCL):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

**Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.

**Maximum Residual Disinfectant Level (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**Maximum Residual Disinfectant Level Goal (MRDLG):** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

**mg/L:** Milligrams per liter

**NA:** Not analyzed or not applicable (when used in average column, only one data point is available)

**ND:** Not detected at or above the reporting level

**ng/L:** Nanograms per liter

**NTU:** Nephelometric turbidity units

**Primary Drinking Water Standard:** MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

**Public Health Goal (PHG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

**Regulatory Action Level (AL):** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

**RAA:** Running Annual Average

**Secondary Drinking Water Standard:** MCLs for contaminants that affect the odor, taste or appearance of water.

**Treatment Technique (TT):** A required process intended to reduce the level of a contaminant in drinking water.

**µg/L:** Micrograms per liter

**µmhos/cm:** Micromhos per centimeter

# CONTRA COSTA WATER DISTRICT

## Table of Chemicals or Constituents Detected in Water in 2016

|                                       | STATE OR<br>FEDERAL<br>GOAL (PHG,<br>MCLG OR<br>MRDLG)              | HIGHEST<br>AMOUNT<br>ALLOWED<br>(MCL OR<br>MRDL) | Contra Costa<br>Water District                        |                                                         | Randall-Bold WTP                                     |                                                         | CCWD-Brentwood<br>WTP                                |                                                         | MAJOR SOURCE IN DRINKING WATER                                                                                                |
|---------------------------------------|---------------------------------------------------------------------|--------------------------------------------------|-------------------------------------------------------|---------------------------------------------------------|------------------------------------------------------|---------------------------------------------------------|------------------------------------------------------|---------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------|
|                                       |                                                                     |                                                  | RANGE<br>DETECTED                                     | AVERAGE                                                 | RANGE<br>DETECTED                                    | AVERAGE                                                 | RANGE<br>DETECTED                                    | AVERAGE                                                 |                                                                                                                               |
| Primary Drinking Water Standards      | Contaminants that may affect health                                 |                                                  |                                                       |                                                         |                                                      |                                                         |                                                      |                                                         |                                                                                                                               |
| INORGANIC                             |                                                                     |                                                  |                                                       |                                                         |                                                      |                                                         |                                                      |                                                         |                                                                                                                               |
| Fluoride (mg/L)                       | 1                                                                   | 2.0                                              | 0.6-0.8                                               | 0.7                                                     | 0.6-0.7                                              | 0.7                                                     | ND                                                   | ND                                                      | Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories      |
| Nitrate as N (mg/L)                   | 10                                                                  | 10                                               | ND                                                    | ND                                                      | ND-1.1                                               | ND                                                      | ND                                                   | ND                                                      | Runoff and leaching from fertilizer use; leaching from septic tanks and sewage; erosion of natural deposits                   |
| LEAD AND COPPER                       | PHG                                                                 | ACTION LIMIT                                     | # OF SITES<br>TESTED / #<br>EXCEEDING<br>ACTION LEVEL | 90%<br>PERCENTILE                                       | # OF SITES<br>TESTED / #<br>EXCEEDING<br>ACTION LEVE | 90%<br>PERCENTILE                                       | # OF SITES<br>TESTED / #<br>EXCEEDING<br>ACTION LEVE | 90%<br>PERCENTILE                                       |                                                                                                                               |
| Lead (µg/L)                           | 0.2                                                                 | 15                                               | 64/0                                                  | ND                                                      | n/a                                                  | n/a                                                     | n/a                                                  | n/a                                                     | Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits |
| Copper (mg/L)                         | 0.3                                                                 | 1.3                                              | 64/0                                                  | 0.17                                                    | n/a                                                  | n/a                                                     | n/a                                                  | n/a                                                     | Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives               |
| Date of sampling                      |                                                                     |                                                  | Jun-16                                                |                                                         | n/a                                                  |                                                         | n/a                                                  |                                                         |                                                                                                                               |
| MICROBIOLOGICAL STANDARDS             |                                                                     |                                                  |                                                       |                                                         |                                                      |                                                         |                                                      |                                                         |                                                                                                                               |
| Total coliform                        | n/a                                                                 | >5% of<br>monthly<br>samples                     | 0%-1.1%                                               | 0.22%                                                   | n/a                                                  | n/a                                                     | n/a                                                  | n/a                                                     |                                                                                                                               |
|                                       |                                                                     |                                                  | MAXIMUM<br>VALUE                                      | LOWEST<br>MONTHLY<br>% OF<br>SAMPLES THAT<br>MEETS REQ. | MAXIMUM<br>VALUE                                     | LOWEST<br>MONTHLY<br>% OF<br>SAMPLES THAT<br>MEETS REQ. | MAXIMUM<br>VALUE                                     | LOWEST<br>MONTHLY<br>% OF<br>SAMPLES THAT<br>MEETS REQ. |                                                                                                                               |
| Turbidity (NTU) (treatment plant)     | n/a                                                                 | TT                                               | 0.14                                                  | 100%                                                    | 0.13                                                 | 100%                                                    | 0.14                                                 | 100%                                                    | Soil runoff                                                                                                                   |
| DISINFECTANT/DISINFECTION BYPRODUCTS  |                                                                     |                                                  | RANGE<br>DETECTED                                     | HIGHEST<br>RAA                                          | RANGE<br>DETECTED                                    | HIGHEST<br>RAA                                          | RANGE<br>DETECTED                                    | HIGHEST<br>RAA                                          |                                                                                                                               |
| Chloramines as Cl <sub>2</sub> (mg/L) | n/a                                                                 | 4                                                | ND-3.8                                                | 1.5                                                     | n/a                                                  | n/a                                                     | n/a                                                  | n/a                                                     | Drinking water disinfectant added for treatment                                                                               |
| Haloacetic acids (µg/L)               | n/a                                                                 | 60                                               | ND-15                                                 | 9                                                       | n/a                                                  | n/a                                                     | n/a                                                  | n/a                                                     | Byproduct of drinking water disinfection                                                                                      |
| Total trihalomethanes (µg/L)          | n/a                                                                 | 80                                               | 4.3-53                                                | 39                                                      | n/a                                                  | n/a                                                     | n/a                                                  | n/a                                                     | Byproduct of drinking water disinfection                                                                                      |
| Secondary Drinking Water Standards    | Contaminants that may affect the odor, taste or appearance of water |                                                  |                                                       |                                                         |                                                      |                                                         |                                                      |                                                         |                                                                                                                               |
| Chloride (mg/L)                       | n/a                                                                 | 500                                              | 68-100                                                | 84                                                      | 29-100                                               | 63                                                      | 30-190                                               | 99                                                      | Runoff/leaching from natural deposits; seawater influence                                                                     |
| Odor-threshold (units)                | n/a                                                                 | 3                                                | 1                                                     | n/a                                                     | 1-4                                                  | 2                                                       | 1                                                    | n/a                                                     | Naturally-occurring organic materials                                                                                         |
| Specific conductivity (µmhos/cm)      | n/a                                                                 | 1,600                                            | 470-670                                               | 520                                                     | 310-670                                              | 460                                                     | 300-850                                              | 550                                                     | Substances that form ions when in water; seawater influence                                                                   |
| Sulfate (mg/L)                        | n/a                                                                 | 500                                              | 43-86                                                 | 60                                                      | 38-81                                                | 54                                                      | 37-68                                                | 54                                                      | Runoff/leaching from natural deposits; industrial wastes                                                                      |
| Total dissolved solids (mg/L)         | n/a                                                                 | 1,000                                            | 240-360                                               | 280                                                     | 180-310                                              | 240                                                     | 170-440                                              | 300                                                     | Runoff/leaching from natural deposits                                                                                         |
| Turbidity (NTU) (distribution system) | n/a                                                                 | 5                                                | 0.01-2.5                                              | 0.15                                                    | n/a                                                  | n/a                                                     | n/a                                                  | n/a                                                     | Soil runoff                                                                                                                   |
| General Water Quality Parameters      | Non-regulated parameters of general interest to consumers           |                                                  |                                                       |                                                         |                                                      |                                                         |                                                      |                                                         |                                                                                                                               |
| Alkalinity (mg/L)                     | n/a                                                                 | n/a                                              | 55-73                                                 | 62                                                      | 46-110                                               | 61                                                      | 41-60                                                | 54                                                      |                                                                                                                               |
| Ammonia (mg/L)                        | n/a                                                                 | n/a                                              | 0.5                                                   | n/a                                                     | 0.4                                                  | n/a                                                     | 0.5                                                  | n/a                                                     |                                                                                                                               |
| Bromide (mg/L)                        | n/a                                                                 | n/a                                              | ND-0.19                                               | 0.1                                                     | ND-0.22                                              | 0.12                                                    | ND-0.32                                              | 0.18                                                    |                                                                                                                               |
| Calcium (mg/L)                        | n/a                                                                 | n/a                                              | 16-26                                                 | 19                                                      | 11-35                                                | 17                                                      | 12-18                                                | 14                                                      |                                                                                                                               |
| Hardness (mg/L)                       | n/a                                                                 | n/a                                              | 76-120                                                | 95                                                      | 58-140                                               | 90                                                      | 64-120                                               | 89                                                      |                                                                                                                               |
| Magnesium (mg/L)                      | n/a                                                                 | n/a                                              | 11-15                                                 | 12                                                      | 8-15                                                 | 11                                                      | 8.2-18                                               | 12                                                      |                                                                                                                               |
| pH                                    | n/a                                                                 | n/a                                              | 8.2-8.7                                               | 8.4                                                     | 7.7-8.8                                              | 8.6                                                     | 7.9-8.8                                              | 8.4                                                     |                                                                                                                               |
| Potassium (mg/L)                      | n/a                                                                 | n/a                                              | 2.6-3.5                                               | 2.9                                                     | 1.8-3.8                                              | 2.6                                                     | 2.0-4.5                                              | 3.0                                                     |                                                                                                                               |
| Sodium (mg/L)                         | n/a                                                                 | n/a                                              | 56-83                                                 | 65                                                      | 39-75                                                | 56                                                      | 36-120                                               | 72                                                      |                                                                                                                               |

# CITY OF ANTIOCH

## Source of Water

The City of Antioch purchases untreated water from CCWD, treats it in a City-owned treatment plant and delivers it to customers through the City's distribution pipes. The City is also able to pump directly from the San Joaquin River or purchase treated water from CCWD.

In April 2003, Antioch conducted a source water assessment. In summary:

- **Antioch Municipal Reservoir** was found to be most vulnerable to sewer collection systems; this activity is not associated with contaminants in the water supply.
- **San Joaquin River** was found to be most vulnerable to the effects of saltwater intrusion, chemical/petroleum processing or storage, and regulated point discharges.

Water from the San Joaquin River is not always acceptable due to saltwater intrusion. When chloride levels in the river exceed 250 milligrams per liter, the City stops pumping until chloride levels decrease.

The City completes watershed sanitary surveys every five years. The last survey, completed in 2012, concluded that potential contamination is regularly mitigated by the natural flushing of the Delta, controls at contamination sources and existing water treatment practices.

## Table of Chemicals or Constituents Detected in Water in 2016

| SUBSTANCE (PARAMETER)                 |                                                                     |                                      | City of Antioch                              |                                              | MAJOR SOURCE IN DRINKING WATER                                                                                                |
|---------------------------------------|---------------------------------------------------------------------|--------------------------------------|----------------------------------------------|----------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------|
|                                       | STATE OR FEDERAL GOAL (PHG, MCLG OR MRDLG)                          | HIGHEST AMOUNT ALLOWED (MCL OR MRDL) | RANGE DETECTED                               | AVERAGE                                      |                                                                                                                               |
| Primary Drinking Water Standards      | Contaminants that may affect health                                 |                                      |                                              |                                              |                                                                                                                               |
| INORGANIC                             |                                                                     |                                      |                                              |                                              |                                                                                                                               |
| Fluoride (mg/L)                       | 1                                                                   | 2.0                                  | 0.6-1.1                                      | 0.7                                          | Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories      |
| Nitrate as N (mg/L)                   | 10                                                                  | 10                                   | ND-0.5                                       | ND                                           | Runoff and leaching from fertilizer use; leaching from septic tanks and sewage; erosion of natural deposits                   |
| LEAD AND COPPER                       | PHG                                                                 | ACTION LIMIT                         | # OF SITES TESTED / # EXCEEDING ACTION LEVEL | 90% PERCENTILE                               |                                                                                                                               |
| Lead (µg/L)                           | 0.2                                                                 | 15                                   | 65/0                                         | ND                                           | Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits |
| Copper (mg/L)                         | 0.3                                                                 | 1.3                                  | 65/0                                         | 0.098                                        | Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives               |
| Date of sampling                      |                                                                     |                                      | August 2015                                  |                                              |                                                                                                                               |
| MICROBIOLOGICAL STANDARDS             |                                                                     |                                      | MAXIMUM VALUE                                | LOWEST MONTHLY % OF SAMPLES THAT MEETS REQ.. |                                                                                                                               |
| Turbidity (NTU) (treatment plant)     | n/a                                                                 | TT                                   | 0.19                                         | 100%                                         | Soil runoff                                                                                                                   |
| DISINFECTANT/DISINFECTION BYPRODUCTS  |                                                                     |                                      | RANGE DETECTED                               | HIGHEST RAA                                  |                                                                                                                               |
| Chloramines as Cl <sub>2</sub> (mg/L) | n/a                                                                 | 4                                    | 0.15-3.5                                     | 2.1                                          | Drinking water disinfectant added for treatment                                                                               |
| Haloacetic acids (µg/L)               | n/a                                                                 | 60                                   | 0-5.8                                        | 6                                            | Byproduct of drinking water disinfection                                                                                      |
| Total trihalomethanes (µg/L)          | n/a                                                                 | 80                                   | 48-74                                        | 76                                           | Byproduct of drinking water disinfection                                                                                      |
| Secondary Drinking Water Standards    | Contaminants that may affect the odor, taste or appearance of water |                                      |                                              |                                              |                                                                                                                               |
| Chloride (mg/L)                       | n/a                                                                 | 500                                  | 32-120                                       | 79                                           | Runoff/leaching from natural deposits; seawater influence                                                                     |
| Odor-threshold (units)                | n/a                                                                 | 3 units                              | 1-4                                          | 2                                            | Naturally-occurring organic materials                                                                                         |
| Specific conductivity (µmhos/cm)      | n/a                                                                 | 1600                                 | 330-720                                      | 510                                          | Substances that form ions when in water; seawater influence                                                                   |
| Sulfate (mg/L)                        | n/a                                                                 | 500                                  | 46-50                                        | 48                                           | Runoff/leaching from natural deposits; industrial wastes                                                                      |
| Total dissolved solids (mg/L)         | n/a                                                                 | 1000                                 | 320-330                                      | 320                                          | Runoff/leaching from natural deposits                                                                                         |
| Turbidity (NTU) (distribution system) | n/a                                                                 | 5                                    | 0.05-0.14                                    | 0.08                                         | Soil runoff                                                                                                                   |
| General Water Quality Parameters      | Non-regulated parameters of general interest to consumers           |                                      |                                              |                                              |                                                                                                                               |
| Alkalinity (mg/L)                     | n/a                                                                 | n/a                                  | 48-110                                       | 69                                           |                                                                                                                               |
| Ammonia (mg/L)                        | n/a                                                                 | n/a                                  | 0.7                                          | n/a                                          |                                                                                                                               |
| Bromide (mg/L)                        | n/a                                                                 | n/a                                  | 0.17                                         | n/a                                          |                                                                                                                               |
| Calcium (mg/L)                        | n/a                                                                 | n/a                                  | 12-32                                        | 17                                           |                                                                                                                               |
| Hardness (mg/L)                       | n/a                                                                 | n/a                                  | 58-140                                       | 84                                           |                                                                                                                               |
| Magnesium (mg/L)                      | n/a                                                                 | n/a                                  | 13                                           | n/a                                          |                                                                                                                               |
| pH                                    | n/a                                                                 | n/a                                  | 8.0-9.0                                      | 8.6                                          |                                                                                                                               |
| Potassium (mg/L)                      | n/a                                                                 | n/a                                  | 3.2                                          | n/a                                          |                                                                                                                               |
| Sodium (mg/L)                         | n/a                                                                 | n/a                                  | 21-84                                        | 53                                           |                                                                                                                               |

# DIABLO WATER DISTRICT

## Table of Chemicals or Constituents Detected in Water in 2016

| SUBSTANCE (PARAMETER)                 | STATE OR FEDERAL GOAL (PHG, MCLG OR MRDLG)                          | HIGHEST AMOUNT ALLOWED (MCL OR MRDL) | Diablo Water District                        |                                             | Randall-Bold WTP                             |                                             | MAJOR SOURCE IN DRINKING WATER                                                                                                                                                                     |
|---------------------------------------|---------------------------------------------------------------------|--------------------------------------|----------------------------------------------|---------------------------------------------|----------------------------------------------|---------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                                       |                                                                     |                                      | RANGE DETECTED                               | AVERAGE                                     | RANGE DETECTED                               | AVERAGE                                     |                                                                                                                                                                                                    |
| Primary Drinking Water Standards      | Contaminants that may affect health                                 |                                      |                                              |                                             |                                              |                                             |                                                                                                                                                                                                    |
| INORGANIC                             |                                                                     |                                      |                                              |                                             |                                              |                                             |                                                                                                                                                                                                    |
| Cadmium (µg/L)                        | 0.04                                                                | 5                                    | 1.4                                          | n/a                                         | ND                                           | n/a                                         | Internal corrosion of galvanized pipes; erosion of natural deposits; discharge from electroplating and industrial chemical factories, and metal refineries; runoff from waste batteries and paints |
| Fluoride (mg/L)                       | 1                                                                   | 2.0                                  | 0.6-0.7                                      | 0.6                                         | 0.6-0.7                                      | 0.7                                         | Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories                                                                           |
| Nitrate as N (mg/L)                   | 10                                                                  | 10                                   | ND-1.1                                       | ND                                          | ND-1.1                                       | ND                                          | Runoff and leaching from fertilizer use; leaching from septic tanks and sewage; erosion of natural deposits                                                                                        |
| LEAD AND COPPER                       |                                                                     | ACTION LIMIT                         | # OF SITES TESTED / # EXCEEDING ACTION LEVEL | 90% PERCENTILE                              | # OF SITES TESTED / # EXCEEDING ACTION LEVEL | 90% PERCENTILE                              |                                                                                                                                                                                                    |
| Lead (µg/L)                           | 0.2                                                                 | 15                                   | 31/0                                         | ND                                          | n/a                                          | n/a                                         | Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits                                                                      |
| Copper (mg/L)                         | 0.3                                                                 | 1.3                                  | 31/0                                         | 0.17                                        | n/a                                          | n/a                                         | Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives                                                                                    |
| Date of sampling                      |                                                                     |                                      | Jun-16                                       |                                             | n/a                                          |                                             |                                                                                                                                                                                                    |
| MICROBIOLOGICAL STANDARDS             |                                                                     |                                      | MAXIMUM VALUE                                | LOWEST MONTHLY % OF SAMPLES THAT MEETS REQ. | MAXIMUM VALUE                                | LOWEST MONTHLY % OF SAMPLES THAT MEETS REQ. |                                                                                                                                                                                                    |
| Turbidity (NTU) (treatment plant)     | n/a                                                                 | TT                                   | n/a                                          | n/a                                         | 0.13                                         | 100%                                        | Soil runoff                                                                                                                                                                                        |
| DISINFECTANT/DISINFECTION BYPRODUCTS  |                                                                     |                                      | RANGE DETECTED                               | HIGHEST RAA                                 | RANGE DETECTED                               | HIGHEST RAA                                 |                                                                                                                                                                                                    |
| Chloramines as Cl <sub>2</sub> (mg/L) | n/a                                                                 | 4                                    | ND-4.5                                       | 2.4                                         | n/a                                          | n/a                                         | Drinking water disinfectant added for treatment                                                                                                                                                    |
| Haloacetic acids (µg/L)               | n/a                                                                 | 60                                   | ND-13                                        | 4                                           | n/a                                          | n/a                                         | Byproduct of drinking water disinfection                                                                                                                                                           |
| Total trihalomethanes (µg/L)          | n/a                                                                 | 80                                   | 4.5-40                                       | 22                                          | n/a                                          | n/a                                         | Byproduct of drinking water disinfection                                                                                                                                                           |
| Secondary Drinking Water Standards    | Contaminants that may affect the odor, taste or appearance of water |                                      |                                              |                                             |                                              |                                             |                                                                                                                                                                                                    |
| Chloride (mg/L)                       | n/a                                                                 | 500                                  | 38-100                                       | 70                                          | 29-100                                       | 63                                          | Runoff/leaching from natural deposits; seawater influence                                                                                                                                          |
| Manganese (µg/L)                      | n/a                                                                 | 50                                   | ND-250                                       | ND                                          | ND                                           | n/a                                         | Leaching from natural deposits                                                                                                                                                                     |
| Odor-threshold (units)                | n/a                                                                 | 3 units                              | 3                                            | n/a                                         | 1-4                                          | 2                                           | Naturally-occurring organic materials                                                                                                                                                              |
| Specific conductivity (µmhos/cm)      | n/a                                                                 | 1600                                 | 390-680                                      | 540                                         | 310-670                                      | 460                                         | Substances that form ions when in water; seawater influence                                                                                                                                        |
| Sulfate (mg/L)                        | n/a                                                                 | 500                                  | 48-88                                        | 70                                          | 38-81                                        | 54                                          | Runoff/leaching from natural deposits; industrial wastes                                                                                                                                           |
| Total dissolved solids (mg/L)         | n/a                                                                 | 1000                                 | 220-360                                      | 300                                         | 180-310                                      | 240                                         | Runoff/leaching from natural deposits                                                                                                                                                              |
| Turbidity (NTU) (distribution system) | n/a                                                                 | 5                                    | 0.01-0.85                                    | 0.26                                        | n/a                                          | n/a                                         | Soil runoff                                                                                                                                                                                        |
| General Water Quality Parameters      | Non-regulated parameters of general interest to consumers           |                                      |                                              |                                             |                                              |                                             |                                                                                                                                                                                                    |
| Alkalinity (mg/L)                     | n/a                                                                 | n/a                                  | 62-120                                       | 80                                          | 46-110                                       | 61                                          |                                                                                                                                                                                                    |
| Ammonia (mg/L)                        | n/a                                                                 | n/a                                  | 0.4                                          | n/a                                         | 0.4                                          | n/a                                         |                                                                                                                                                                                                    |
| Bromide (mg/L)                        | n/a                                                                 | n/a                                  | 0.07-0.23                                    | 0.14                                        | ND-0.22                                      | 0.12                                        |                                                                                                                                                                                                    |
| Calcium (mg/L)                        | n/a                                                                 | n/a                                  | 18-38                                        | 24                                          | 11-35                                        | 17                                          |                                                                                                                                                                                                    |
| Hardness (mg/L)                       | n/a                                                                 | n/a                                  | 82-160                                       | 120                                         | 58-140                                       | 90                                          |                                                                                                                                                                                                    |
| Magnesium (mg/L)                      | n/a                                                                 | n/a                                  | 10-17                                        | 14                                          | 8-15                                         | 11                                          |                                                                                                                                                                                                    |
| pH                                    | n/a                                                                 | n/a                                  | 7.8-8.5                                      | 8.3                                         | 7.7-8.8                                      | 8.6                                         |                                                                                                                                                                                                    |
| Potassium (mg/L)                      | n/a                                                                 | n/a                                  | 1.9-3.6                                      | 2.6                                         | 1.8-3.8                                      | 2.6                                         |                                                                                                                                                                                                    |
| Sodium (mg/L)                         | n/a                                                                 | n/a                                  | 45-82                                        | 63                                          | 39-75                                        | 56                                          |                                                                                                                                                                                                    |

## Source of Water

Diablo Water District purchases untreated water from CCWD. Water is treated and blended with groundwater pumped from two wells. The treated water is then delivered to customers through its distributions pipes.

A source water assessment was conducted for Glen Park well in April 2005 and for Stonecreek well in March 2011. In summary:

- Both wells** were found to be most vulnerable to historic waste dumps/landfills and septic systems (high density, >1/acre). These activities are not associated with contaminants in the water supply.

## Source of Water

Diablo Water District purchases untreated water from CCWD.

Water is treated and blended with groundwater pumped from two wells. The treated water is then delivered to customers through its distributions pipes.

A source water assessment was conducted for Glen Park well in April 2005 and for Stonecreek well in March 2011. In summary:

- **Both wells** were found to be most vulnerable to historic waste dumps/landfills and septic systems (high density, >1/acre). These activities are not associated with contaminants in the water supply.

# CITY OF MARTINEZ

## Source of Water

The City of Martinez purchases untreated water from CCWD, treats it in a City-owned treatment plant and delivers it through the City's distribution pipes to customers who are not served treated water directly from CCWD.

## Table of Chemicals or Constituents Detected in Water in 2016

| SUBSTANCE (PARAMETER)                 |                                                                     |                                      | City of Martinez                             |                                             | MAJOR SOURCE IN DRINKING WATER                                                                                                |
|---------------------------------------|---------------------------------------------------------------------|--------------------------------------|----------------------------------------------|---------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------|
|                                       | STATE OR FEDERAL GOAL (PHG, MCLG OR MRDLG)                          | HIGHEST AMOUNT ALLOWED (MCL OR MRDL) | RANGE DETECTED                               | AVERAGE                                     |                                                                                                                               |
| Primary Drinking Water Standards      | Contaminants that may affect health                                 |                                      |                                              |                                             |                                                                                                                               |
| INORGANIC                             |                                                                     |                                      |                                              |                                             |                                                                                                                               |
| Fluoride (mg/L)                       | 1                                                                   | 2.0                                  | 0.6-1                                        | 0.8                                         | Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories      |
| LEAD AND COPPER                       | PHG                                                                 | ACTION LIMIT                         | # OF SITES TESTED / # EXCEEDING ACTION LEVEL | 90% PERCENTILE                              |                                                                                                                               |
| Lead (µg/L)                           | 0.2                                                                 | 15                                   | 63/0                                         | ND                                          | Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits |
| Copper (mg/L)                         | 0.3                                                                 | 1.3                                  | 63/0                                         | 0.12                                        | Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives               |
| Date of sampling                      |                                                                     |                                      | Jun-16                                       |                                             |                                                                                                                               |
| MICROBIOLOGICAL STANDARDS             |                                                                     |                                      | MAXIMUM VALUE                                | LOWEST MONTHLY % OF SAMPLES THAT MEETS REQ. |                                                                                                                               |
| Turbidity (NTU) (treatment plant)     | n/a                                                                 | TT                                   | 0.14                                         | 100%                                        | Soil runoff                                                                                                                   |
| DISINFECTANT/DISINFECTION BYPRODUCTS  |                                                                     |                                      | RANGE DETECTED                               | HIGHEST RAA                                 |                                                                                                                               |
| Chloramines as Cl <sub>2</sub> (mg/L) | n/a                                                                 | 4                                    | 0.1-3.0                                      | 1.2                                         | Drinking water disinfectant added for treatment                                                                               |
| Bromate (µg/L)                        | 0.1                                                                 | 10                                   | ND-9                                         | 3                                           | Byproduct of drinking water disinfection                                                                                      |
| Haloacetic acids (µg/L)               | n/a                                                                 | 60                                   | ND-3.2                                       | 2                                           | Byproduct of drinking water disinfection                                                                                      |
| Total trihalomethanes (µg/L)          | n/a                                                                 | 80                                   | 3.6-22                                       | 12                                          | Byproduct of drinking water disinfection                                                                                      |
| Secondary Drinking Water Standards    | Contaminants that may affect the odor, taste or appearance of water |                                      |                                              |                                             |                                                                                                                               |
| Chloride (mg/L)                       | n/a                                                                 | 500                                  | 37-130                                       | 74                                          | Runoff/leaching from natural deposits; seawater influence                                                                     |
| Odor-threshold (units)                | n/a                                                                 | 3 units                              | 1-2                                          | 1                                           | Naturally-occurring organic materials                                                                                         |
| Specific conductivity (µmhos/cm)      | n/a                                                                 | 1600                                 | 350-600                                      | 480                                         | Substances that form ions when in water; seawater influence                                                                   |
| Sulfate (mg/L)                        | n/a                                                                 | 500                                  | 43-61                                        | 52                                          | Runoff/leaching from natural deposits; industrial wastes                                                                      |
| Total dissolved solids (mg/L)         | n/a                                                                 | 1000                                 | 180-350                                      | 260                                         | Runoff/leaching from natural deposits                                                                                         |
| Turbidity (NTU) (distribution system) | n/a                                                                 | 5                                    | 0.07-0.3                                     | 0.13                                        | Soil runoff                                                                                                                   |
| General Water Quality Parameters      |                                                                     |                                      |                                              |                                             |                                                                                                                               |
| Alkalinity (mg/L)                     | n/a                                                                 | n/a                                  | 56-100                                       | 78                                          |                                                                                                                               |
| Bromide (mg/L)                        | n/a                                                                 | n/a                                  | 0.10-0.36                                    | 0.2                                         |                                                                                                                               |
| Calcium (mg/L)                        | n/a                                                                 | n/a                                  | 13-31                                        | 22                                          |                                                                                                                               |
| Hardness (mg/L)                       | n/a                                                                 | n/a                                  | 68-140                                       | 100                                         |                                                                                                                               |
| Magnesium (mg/L)                      | n/a                                                                 | n/a                                  | 8.6-14                                       | 11                                          |                                                                                                                               |
| pH                                    | n/a                                                                 | n/a                                  | 7.3-9.2                                      | 8.8                                         |                                                                                                                               |
| Potassium (mg/L)                      | n/a                                                                 | n/a                                  | 2.2-3.4                                      | 2.8                                         |                                                                                                                               |
| Sodium (mg/L)                         | n/a                                                                 | n/a                                  | 42-64                                        | 53                                          |                                                                                                                               |

## Table of Chemicals or Constituents Detected in Water in 2016

| SUBSTANCE (PARAMETER)                 | STATE OR FEDERAL GOAL (PHG, MCLG OR MRDLG)                          | HIGHEST AMOUNT ALLOWED (MCL OR MRDL) | City of Pittsburgh                           |                                             | MAJOR SOURCE IN DRINKING WATER                                                                                                |
|---------------------------------------|---------------------------------------------------------------------|--------------------------------------|----------------------------------------------|---------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------|
|                                       |                                                                     |                                      | RANGE DETECTED                               | AVERAGE                                     |                                                                                                                               |
| Primary Drinking Water Standards      | Contaminants that may affect health                                 |                                      |                                              |                                             |                                                                                                                               |
| INORGANIC                             |                                                                     |                                      |                                              |                                             |                                                                                                                               |
| Fluoride (mg/L)                       | 1                                                                   | 2.0                                  | 0.5-0.9                                      | 0.7                                         | Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories      |
| Nitrate as N (mg/L)                   | 10                                                                  | 10                                   | 0.69                                         | n/a                                         | Runoff and leaching from fertilizer use; leaching from septic tanks and sewage; erosion of natural deposits                   |
| LEAD AND COPPER                       | PHG                                                                 | ACTION LIMIT                         | # OF SITES TESTED / # EXCEEDING ACTION LEVEL | 90% PERCENTILE                              |                                                                                                                               |
| Lead (µg/L)                           | 0.2                                                                 | 15                                   | 47/0                                         | ND                                          | Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits |
| Copper (mg/L)                         | 0.3                                                                 | 1.3                                  | 47/0                                         | ND                                          | Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives               |
| Date of sampling                      |                                                                     |                                      | Aug-15                                       |                                             |                                                                                                                               |
| MICROBIOLOGICAL STANDARDS             |                                                                     |                                      | MAXIMUM VALUE                                | LOWEST MONTHLY % OF SAMPLES THAT MEETS REQ. |                                                                                                                               |
| Turbidity (NTU) (treatment plant)     | n/a                                                                 | TT                                   | 0.12                                         | 100%                                        | Soil runoff                                                                                                                   |
| DISINFECTANT/DISINFECTION BYPRODUCTS  |                                                                     |                                      | RANGE DETECTED                               | HIGHEST RAA                                 |                                                                                                                               |
| Chloramines as Cl <sub>2</sub> (mg/L) | n/a                                                                 | 4                                    | 0.1-3.4                                      | 1.2                                         | Drinking water disinfectant added for treatment                                                                               |
| Haloacetic acids (µg/L)               | n/a                                                                 | 60                                   | ND-16                                        | 8                                           | Byproduct of drinking water disinfection                                                                                      |
| Total trihalomethanes (µg/L)          | n/a                                                                 | 80                                   | 8.5-36                                       | 24                                          | Byproduct of drinking water disinfection                                                                                      |
| Secondary Drinking Water Standards    | Contaminants that may affect the odor, taste or appearance of water |                                      |                                              |                                             |                                                                                                                               |
| Chloride (mg/L)                       | n/a                                                                 | 500                                  | 53-140                                       | 94                                          | Runoff/leaching from natural deposits; seawater influence                                                                     |
| Color                                 | n/a                                                                 | 15 units                             | ND-9                                         | 3.5                                         | Naturally-occurring organic materials                                                                                         |
| Odor-threshold (units)                | n/a                                                                 | 3 units                              | 1.3-1.6                                      | 1.3                                         | Naturally-occurring organic materials                                                                                         |
| Specific conductivity (µmhos/cm)      | n/a                                                                 | 1600                                 | 370-840                                      | 670                                         | Substances that form ions when in water; seawater influence                                                                   |
| Sulfate (mg/L)                        | n/a                                                                 | 500                                  | 76-110                                       | 90                                          | Runoff/leaching from natural deposits; industrial wastes                                                                      |
| Total dissolved solids (mg/L)         | n/a                                                                 | 1000                                 | 280-470                                      | 390                                         | Runoff/leaching from natural deposits                                                                                         |
| Turbidity (NTU) (distribution system) | n/a                                                                 | 5                                    | 0.05-0.3                                     | 0.12                                        | Soil runoff                                                                                                                   |
| General Water Quality Parameters      | Non-regulated parameters of general interest to consumers           |                                      |                                              |                                             |                                                                                                                               |
| Alkalinity (mg/L)                     | n/a                                                                 | n/a                                  | 46-120                                       | 68                                          |                                                                                                                               |
| Ammonia (mg/L)                        | n/a                                                                 | n/a                                  | ND-0.58                                      | 0.29                                        |                                                                                                                               |
| Calcium (mg/L)                        | n/a                                                                 | n/a                                  | 30                                           | n/a                                         |                                                                                                                               |
| Hardness (mg/L)                       | n/a                                                                 | n/a                                  | 110-210                                      | 160                                         |                                                                                                                               |
| Magnesium (mg/L)                      | n/a                                                                 | n/a                                  | 16                                           | n/a                                         |                                                                                                                               |
| pH                                    | n/a                                                                 | n/a                                  | 7.2-8.8                                      | 8.5                                         |                                                                                                                               |
| Potassium (mg/L)                      | n/a                                                                 | n/a                                  | 3.2                                          | n/a                                         |                                                                                                                               |
| Sodium (mg/L)                         | n/a                                                                 | n/a                                  | 34-110                                       | 62                                          |                                                                                                                               |

### Source of Water

The City of Pittsburgh purchases untreated water from CCWD, treats it in a City-owned treatment plant and delivers it to customers through the City's distribution pipes. In addition to the water it buys from CCWD, the City is able to pump water from two wells.

A source water assessment was conducted for the Rossmoor well in November 2001, and for the Bodega well in July 2009. In summary:

- **Bodega well** was found to be most vulnerable to residential sewer collection systems, abandoned military installation (Camp Stoneman) and illegal activities (drug labs).
- **Rossmoor well** was found to be most vulnerable to grazing, sewer collection systems, utility stations and maintenance areas.

## How to Get Involved in the Quality of Your Water

### CONTRA COSTA WATER DISTRICT

The Board of Directors meets in regular session at 6:30 p.m. on the first and third Wednesday of each month. Meetings are held in the Board Room at the Contra Costa Water District Center, 1331 Concord Ave., Concord. For meeting agendas, contact the District Secretary at 925-688-8000 or visit [www.ccwater.com](http://www.ccwater.com).

### CITY OF MARTINEZ

The Martinez City Council meets in regular session at 7 p.m. on the first and third Wednesday of each month. Meetings are held in Council Chambers at 525 Henrietta Street, Martinez. For meeting agendas, contact the Deputy City Clerk at 925-372-3512 or visit [www.cityofmartinez.org](http://www.cityofmartinez.org).

### CITY OF PITTSBURG

The Pittsburg City Council meets in regular session at 7 p.m. on the first and third Monday of each month. Meetings are held in Council Chambers at 65 Civic Drive, Pittsburg. For meeting agendas, call 925-252-4850 or visit [www.ci.pittsburg.ca.us](http://www.ci.pittsburg.ca.us).

### CITY OF ANTIOCH

The Antioch City Council meets in regular session at 7 p.m. on the second and fourth Tuesday of each month. Meetings are held in Council Chambers at Third and H streets, Antioch. For meeting agendas, contact the City Clerk at 925-779-7009 or visit [www.ci.antioch.ca.us](http://www.ci.antioch.ca.us).

### DIABLO WATER DISTRICT (OAKLEY)

The Board of Directors meets in regular session at 7:30 p.m. on the fourth Wednesday of each month. Meetings are held at 87 Carol Lane, Oakley. For meeting agendas, contact DWD at 925-625-3798 or visit [www.diablowater.org](http://www.diablowater.org).

## Want more information?

Contra Costa Water District's website contains valuable information about water issues. Visit [www.ccwater.com](http://www.ccwater.com) to begin your research.



CONTRA COSTA  
WATER DISTRICT



This report contains important information about your drinking water. Have someone translate it for you, or speak with someone who understands it.

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.

此报告包含有关您的饮用水的重要信息。请人帮您翻译出来，或请看懂此报告的人将内容说给您听。

این گزارش شامل اطلاعات مهمی در مورد آب  
اشامیدنی شما می باشد. از شخصی بخواهید  
که به شما ترجمه کنند و یا با شخصی که این  
موضوع را میفهمند صحبت کنید.

Mahalaga ang impormasyong ito.  
Mangyaring ipasalin ito.